

US Army Tactical Microgrid System Civilian Application

Design Document

ECE 445
2/23/2020

Team 49
Patrick Yang, pyyang2
Sahil Morrow, sahilsm2
Matt Weberski, mwebers2
TA: Vassily Petrov

1 Introduction

1.2 Objective

The Tactical Microgrid System (TMS) of the US Army Corps of Engineers is a centralized power distribution system developed for seamless deployment in areas that have temporarily lost their means of producing electricity. It is currently deployed in multiple locations, however there exists no integration for this technology in a civilian environment. Our client, the US Army Corps of Engineers, wants us to adapt this project for civilian use.

The goal for our project will be to modify the current TMS deployed by the Army Corps of Engineers to allow for initial power generation with diesel engines and then seamlessly transition to using renewable sources of energy. During this semester we will be working with both Army Corps Engineers and 2 Seniors in the Agricultural Engineering Department. Due to the increased number of stakeholders and the compliance requirements of working with the military, we must follow the administrative guidelines of all involved parties. We will develop a functioning prototype of our design that will be demoed to our stakeholders, namely the US Army Corps of Engineers, the ECE Department, and the ABE Department.

1.2 Background

Across the globe there are still many places that do not have infrastructure in place to deliver sustainable energy to its citizens, or that the power grids in place were destroyed or damaged by natural disasters or outside influences. The current tactical microgrid utilized by the military is not practical or sustainable for civilian use, as it is large, expensive, and requires training to operate. The purpose of the diesel generators would be to provide immediate aid, and then over time use either renewable energy sources or connect to existing grids that would provide a more permanent energy solution. An example is that recent earthquakes in Puerto Rico have damaged its infrastructure, removing multiple areas' access to sustained power. The prototype we will design this semester will be sent to Puerto Rico with a group of students over the summer. A successful project will directly impact the community that our first prototype will be deployed to, and showcase how it can be used to aid other communities across the globe.

1.3 Physical Design

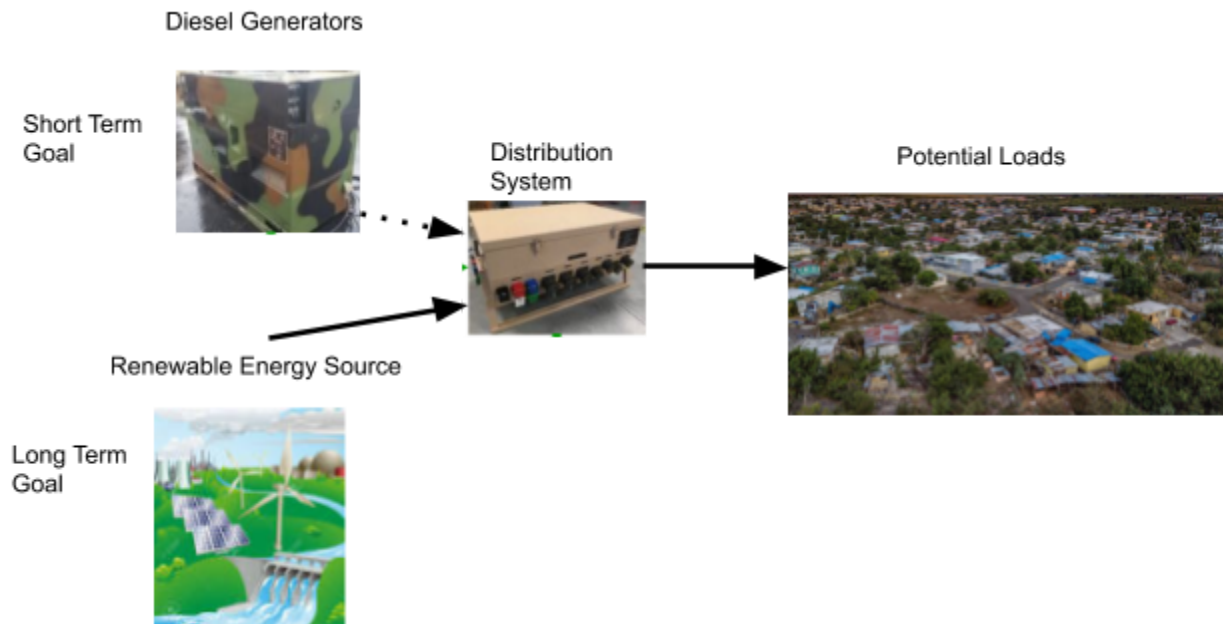


Figure 1: High Level Idea for the Physical Layout

1.4 High Level Requirements

- We must design a modular microgrid system following the USACE's TMS-DDS Protocol
- Our project must be able to adapt its power output (voltage and phases) to match the power grid of Puerto Rico
- We must modify existing microcontroller code for diesel generators to work for other power sources, such as solar panels or hydroelectric power
- The operation of the microgrid should be simple enough to require minimal training to run and maintain; simple enough that a civilian with little to no education could setup and control the microgrid

2 Design

2.1 Block Diagram

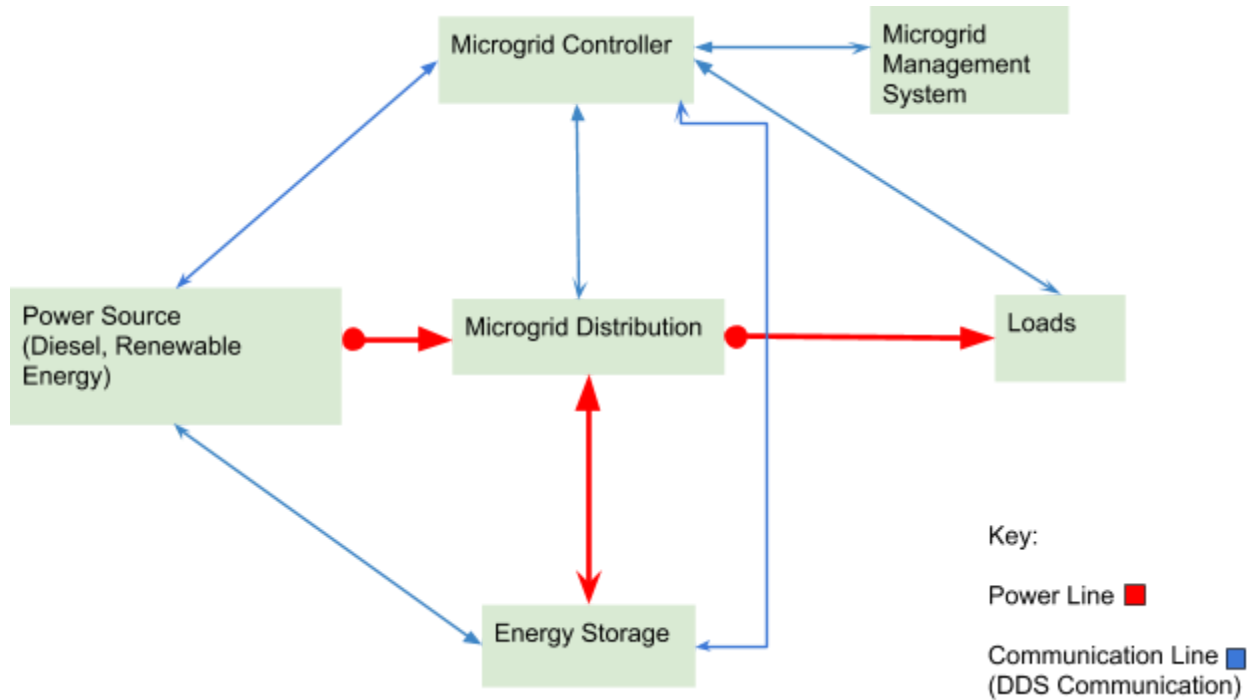


Figure 2: Block Diagram

2.2 Functional Overview

2.2.1: Power Source:

Responsible for delivering power to the microgrid. The types of power sources will be diesel generators for short term use to get electricity up and running in the area, and as an emergency backup. The long term, sustainable option will be to use a renewable energy source. The application would determine the best renewable energy source to use, and for our focus on deploying the microgrid in an interior location, away from the coast of Puerto Rico the renewable energy source we will utilize is solar energy.

Requirement	Verification
1. Capable of providing 180kW input	

power 2. Input power sources provide 120V Single-Phase, 208V Three-Phase power at 60Hz	
---	--

Requirements: The USACE has said that initially 3 generators will be used. 2 are 100 KW modified CAT diesel generators, and the third is a 60 KW modified Cummins diesel generator. The USACE already has these generators, and they have modified them to fit current military applications. We will have to modify these in some way to fit civilian applications. The few requirements that come to mind based on our initial meeting with the USACE is that these generators must be modified so that they can be easily re-integrated into the microgrid when necessary. The end goal is to use renewable energy as the source for the microgrid, and solar was chosen to be the initial focus for this project. We have to keep in mind that these microgrids will be deployed in affected areas where transportation of equipment can be difficult or even impossible by ground. This is why wind power has been excluded because the size of wind turbines make it difficult to transport, as well as reliant on where it is deployed.

2.2.2: Microgrid Distribution:

The distribution system converts the energy produced by the power sources so that the proper amount of power is transferred based on the loads connected to the microgrid. The distribution will also be able to add or take power from the energy storage unit depending on the energy requirements of the microgrid at a given point in time.

Requirement	Verification
1. Must be able to handle the integration of different power sources at different times	

Requirements: The diesel generators are rated to deliver up to 800 Amps of power, so the distribution system has to be able to tolerate that level of current. Transformers will be required to bring the level of voltage down to civilian use, so 120-240 Volts. Converters will also be needed to convert the electricity from the source to DC in case civilian applications call for it. The distribution system will need to operate at all times, so a separate back-up power source will be needed in case the primary power source fails. This will most likely be a back-up battery that is charged by the primary power source. Since the microgrid will be placed in locations that are impacted by weather, this system must be robust and able to tolerate harsh weather conditions. The distribution system will need to communicate the state of the loads with the

microgrid controller, so hardware will need to be installed as well with the ability to quickly let the controller know the state of the loads.

2.2.3: Microgrid Loads:

This block will be the devices that are connected and powered on by the microgrid. The types of devices connected would vary widely depending on the application of the grid and the location that the grid is being deployed to. For our project, the focus will be loads that are plugged into the microgrid must meet the single-phase and three-phase requirements for the country of Puerto Rico. The single-phase grid requirements in Puerto Rico are the same as the United States, the challenge will be with three-phase power because the two standards are different.

Requirement	Verification
<ol style="list-style-type: none"> 1. Single Phase: 120V, 60Hz 2. Three-Phase: 480V, 60Hz 	

Requirements: The loads this microgrid will serve can wildly vary. We know the microgrid will serve civilian applications, so initially we can assume that the distribution system should be able to output 120-240 Volts to the loads.

2.2.4: Energy Storage:

One of the USACE's objectives is that the microgrid should be sustainable; this means that a method of energy storage and an inverter are required when the primary renewable energy sources are not producing enough power to fulfil the loads' demands. Stationary batteries for renewable energy storage are not something new, but further research will be needed to figure what type of batteries are best suited for our design.

Requirement	Verification

Requirements: Will need to communicate with the microgrid controller so that it knows when to turn on and start delivering power to the loads via the distribution system. Will need to be capable of being charged by the primary power sources.

2.2.5: Microgrid Controller:

The microgrid controller is in charge of communicating with all other subsystems so that the state of the microgrid can be monitored and adjustments can be made accordingly. The controller utilizes a DDS communication method to monitor all devices connected to the microgrid, a protocol written and designed by the USACE. The DDS communication protocol acts as an Internet-Of-Things application capable of letting the user know what devices are connected, as well as the profile of the device connected and having control over how it operates. The protocol is highly modular, compatible individual components like generators and loads can be attached and removed with minimal effort. The equipment we select for our project must follow this DDS Protocol.

Requirement	Verification
<ol style="list-style-type: none">1. Shows all devices connected to the microgrid2. Connected devices are recognized and have the proper profile that fits the device's description3. Users can control the devices that the controller recognizes.	

Requirements: The controller is the brain of the microgrid; it has to always be on and therefore will need a back-up power source in case primary power fails. This most likely could be coming from energy storage. Since the USACE would like this microgrid to be scalable, the controller needs to be able to be reprogrammed easily to account for new loads or changes in power generation (more/less diesel generators, integration of renewable energy sources). The testing of our microgrid controller must be compliant with IEEE standard 2030.8. IEEE 2030.8 has a set of testing procedures that microgrid controllers must pass for verification, quantification of performance, and how it compares to minimum requirements. [4]

2.2.6: Microgrid Management System:

The management system for the microgrid controller will be to give us a way to analyze the performance of the microgrid remotely. Also, the system is used by the US Army Corps of Engineers currently to implement cybersecurity measures to protect the microgrid systems from being hacked.

Requirement	Verification

Requirements: Since cybersecurity is one of the USACE’s concerns, this system will need to be robust enough so that it can withstand cyber attacks from threats since it will be hosted on a remote network, separate from the microgrid network. This system is for monitoring purposes only, so there should be no communication back to the grid from this system. On the flip side, the connection between this network and the microgrid network must be robust enough to tolerate physical harm.

2.3 Risk Analysis

The block that will prove to be the the most difficult to get correct will be the microgrid controller. Being able to control how energy is being stored, distributed, and drawn from the energy source will be the key to the successful operation of the microgrid. The controller will have the greatest responsibility, as it will be constantly monitoring the loads that are connected to the grid, which will determine how power will be distributed to each of the loads efficiently. The controller will also be responsible for determining how much energy the microgrid is capable of storing depending on what power sources are being used at the time, whether it is the diesel generators or a clean energy source, and how much power is required to power all connected loads. The efficiency and safe operation of the microgrid will hinge on the success of the controller being able to actively read in the data that it is fed and respond accordingly to ensure power is being utilized properly.

3 Cost and Schedule

3.1 Cost Analysis

Labor: We will assume that our contacts in the USACE will not be receiving wages for this project.

5 Students * 10 hours/week * 10 weeks * 40\$/hour = \$20000

Equipment: Much of the equipment we will use for prototyping is already owned by the USACE, or it will be custom made by the USACE.

3 Generators.

1 Distribution System comprised of multiple different USACE constructed distribution boxes.

1 Microgrid Controller.

1 Management System.

Batteries for energy storage (this part of the project has been outlined as a reach goal by the USACE during the timeframe of our senior design project).

3 PCB Prototypes

3.2 Project Schedule

How does this look?

Feb 24 - March 1:

- [Class] 2/27 Design Document Final Submission
- First trip to the CERL Facility, we were introduced to our primary USACE contact, the available equipment, and our project success criteria

March 2 - March 8:

- [Design] Selection and Research of Parts
- [Design] Connection of Modules

March 9 - March 15:

- [Class] 3/12 Early Bird PCBway Order
- [Class] 3/13 Soldering Assignment
- [Design] Propose Design to USACE
- [Design] Iterate on Feedback from USACE

March 16 - March 22:

- Spring Break

March 23 - March 29:

- [Class] 3/26 First Round PCBway Order
- [Design] PCB
- [Design] Propose design to USACE (2)
- [Prototyping] Begin

March 30 - April 5:

- [Class] 3/30 Individual Progress Reports
- [Prototyping] Module, Power Supply
- [Prototyping] Module, Power Distribution
- [Prototyping] Module, Controller and Interface

April 6 - April 12:

- [Class] 4/6 Final Round PCBway Order
- [Prototyping] Loads
- [Prototyping] PCB integration

- [Design] Final PCB Design

April 13 - April 19:

- Final Prototyping and Testing

April 20 - April 26:

- [Class] Mock Demo
- Presentation Preparation

April 27 - May 3rd:

- [Class] Demonstrations
- Presentation Preparation
- Documentation

May 4th - May 10th:

- [Class] Presentations
- [Class] 5/6 Final Paper, 5/7 Lab Notebook Due

4 Ethics and Safety

The high power levels of our microgrid can lead to serious safety concerns if care is not taken. Each individual diesel generator that we will be utilizing will output power as high as 60kW, with a current limit of 800A. Extreme caution will have to be taken to ensure that the generators, and the grid as a well, is operated in as safe of conditions as possible. Our project is designed for deployment in Puerto Rico; we will use information received from our client to design our system to suited for that environment, but we will also analyze how our system will perform in other environments.

Using diesel generators also leads to another safety risk for the individuals around them during operation. The diesel generators will give off toxic fumes, mostly in the form of carbon monoxide, so it will be essential to make sure that the area that has these generators are sufficiently ventilated to lessen the risk of breathing in the toxic gas. Also the diesel fuel is highly flammable, which will be that this fire hazard must be monitored to ensure the fuel is not unintentionally ignited.

The renewable energy source that is used to take over for diesel generators to make the microgrid more sustainable will also bring up safety hazards as well. The type of renewable energy source used will be based on the environment that the microgrid will be deployed in, but all of the renewable energy sources will be capable of high and extremely dangerous levels of voltage and current that can electrocute an operator.

An ethical issue that our project will face is the pollution caused by running diesel generators. We have an understanding that diesel engines in this capacity are not sustainable in areas with minimal power grid infrastructure in place, which is why renewables energy sources must be capable for our microgrid so that the diesel energy source will serve the purpose of being a back-up power supply in case of emergency. This is in accordance to the IEEE code of ethics, #1, "...to disclose factors that might endanger the public or the environment." [2].

Another ethical issue that our project will face will be that we must have detailed documentation for safe operation of the microgrid. The assumption that we are under is that the individuals using the microgrid long term will not be an experienced technician. According to the IEEE code of ethics, #5, we are responsible "to improve the understanding by individuals and society of the capabilities and societal implications of conventional and emerging technologies..." [2]. This means that we must have clear instructions on how to initially train and operate the microgrid once the system has been deployed, as well as make sure the end user is clear about the purpose of each component and how to safely operate the equipment. Our project partners from the ABE department will be in charge of drafting a safety manual.

5 References:

[1] D. Herring. Presentation. "Tactical Microgrid Standard (TMS)." OMG Technical Meeting, Reston, VA, Mar. 19, 2019. Available: https://d2vkrkwbbxbylk.cloudfront.net/sites/default/files/tms-omg-mars-20190319-release-v2_sm.pdf

[2] ieee.org, "IEEE Code of Ethics", 2016. [Online]. Available: <https://www.ieee.org/about/corporate/governance/p7-8.html>. [Accessed: 13- Feb- 2020].

[3] IEEE Standard for the Specification of Microgrid Controllers," in IEEE Std 2030.7-2017 , vol., no., pp.1-43, 23 April 2018

[4] IEEE Standard for the Testing of Microgrid Controllers," in IEEE Std 2030.8-2018 , vol., no., pp.1-42, 24 Aug. 2018